

TAIXING SAINTY INDUSTRY CO., LTD. MIAMI-DADE TEST REPORT

SCOPE OF WORK

TAS 201, TAS 202 AND TAS 203 TESTING ON STOSW2 CASEMENT WINDOW.

REPORT NUMBER

260616014SHF-001

TEST DATE(S)

2025-11-19 – 2025-11-22

ISSUE DATE

2026-08-18

RECORD RETENTION END DATE

2035-11-22

LABORATORY CERTIFICATION NO.

TST 11491


PAGES

34

DOCUMENT CONTROL NUMBER

LFT-APAC-SHF-OP-10p (September 1, 2022)

© 2022 INTERTEK

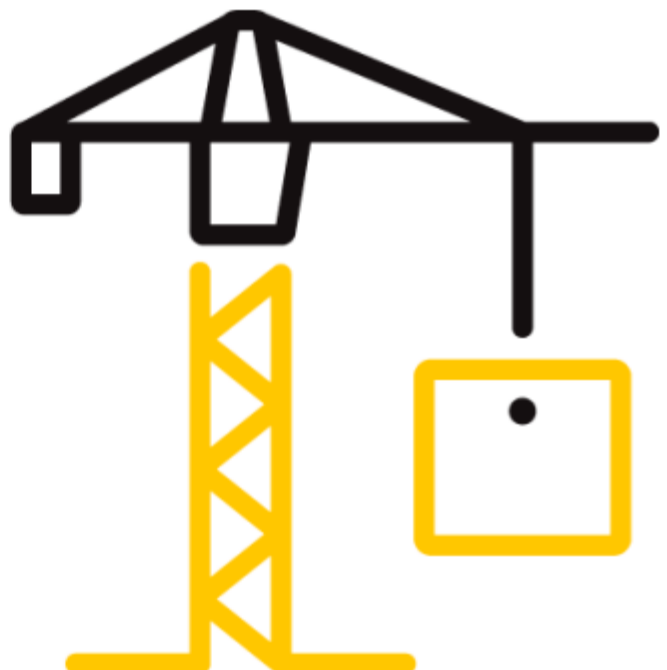

TEST REPORT

Issue Date: 2026-08-18

Intertek Report No.: 260616014SHF-001

REPORT ISSUED TO

TAIXING SAINTY INDUSTRY CO., LTD.

No. 29, Yingxin Road, Hongqiao Town, Taixing City, Jiangsu Province.

SECTION 1

SCOPE

Intertek Building & Construction (B&C) was contracted by Taixing Sainty Industry Co., Ltd. to perform TAS 201, TAS 202, and TAS 203 testing in accordance with Florida Building Code for High Velocity Hurricane Zone and Miami-Dade County requirements on their STOSW2 Aluminum Casement Window. Results obtained are tested values and were secured by using the designated test method(s). Testing was conducted at the Intertek B&C test facility in Plant 3-5, No. 6978 Daye Road, Fengxian District, Shanghai, China. This report does not constitute certification of this product nor an opinion or endorsement by this laboratory. Unless differently required, Intertek reports apply the "Simple Acceptance" rule, also called "Shared Risk approach", of ILAC-G8:09/2019, Guidelines on Decision Rules and Statements of Conformity.

SECTION 2


SUMMARY OF TEST RESULTS

The specimen(s) tested met the performance requirements set forth in the protocols.

Product Type: Casement Window

Series/Model: STOSW2

SPEC.	TEST PROTOCOL	DESIGN PRESSURE
#01	TAS 202	+75.0 / -75.0 psf
	TAS 201/203 (Large Missile)	+75.0 / -75.0 psf
#02	TAS 202 (Structural only)	+75.0 / -75.0 psf
	TAS 201/203 (Large Missile)	+75.0 / -75.0 psf
#03	TAS 201/203 (Large Missile)	+75.0 / -75.0 psf

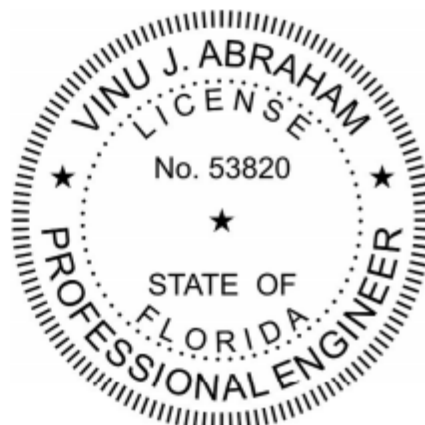

For INTERTEK B&C:

COMPLETED BY: Fred Bao
TITLE: Technical Manager – Intertek B&C
SIGNATURE: *Fred Bao*
DATE: 2026-08-18

REVIEWED BY: Vinu Abraham, P.E.
TITLE: Vice President
SIGNATURE: *V. Abraham*
DATE: 2026-08-18

This report is for the exclusive use of Intertek's Client and is provided pursuant to the agreement between Intertek and its Client. Intertek's responsibility and liability are limited to the terms and conditions of the agreement. Intertek assumes no liability to any party, other than to the Client in accordance with the agreement, for any loss, expense or damage occasioned by the use of this report. Only the Client is authorized to permit copying or distribution of this report and then only in its entirety. Any use of the Intertek name or one of its marks for the sale or advertisement of the tested material, product or service must first be approved in writing by Intertek. The observations and test results in this report are relevant only to the sample(s) tested. This report by itself does not imply that the material, product, or service is or has ever been under an Intertek certification program.

The report was digital signed by Shang Hai, Intertek Group plc, please using Adobe Acrobat Reader to verify the authenticity.